


Recommended Commercial BoilerMate Installation - Two Tanks

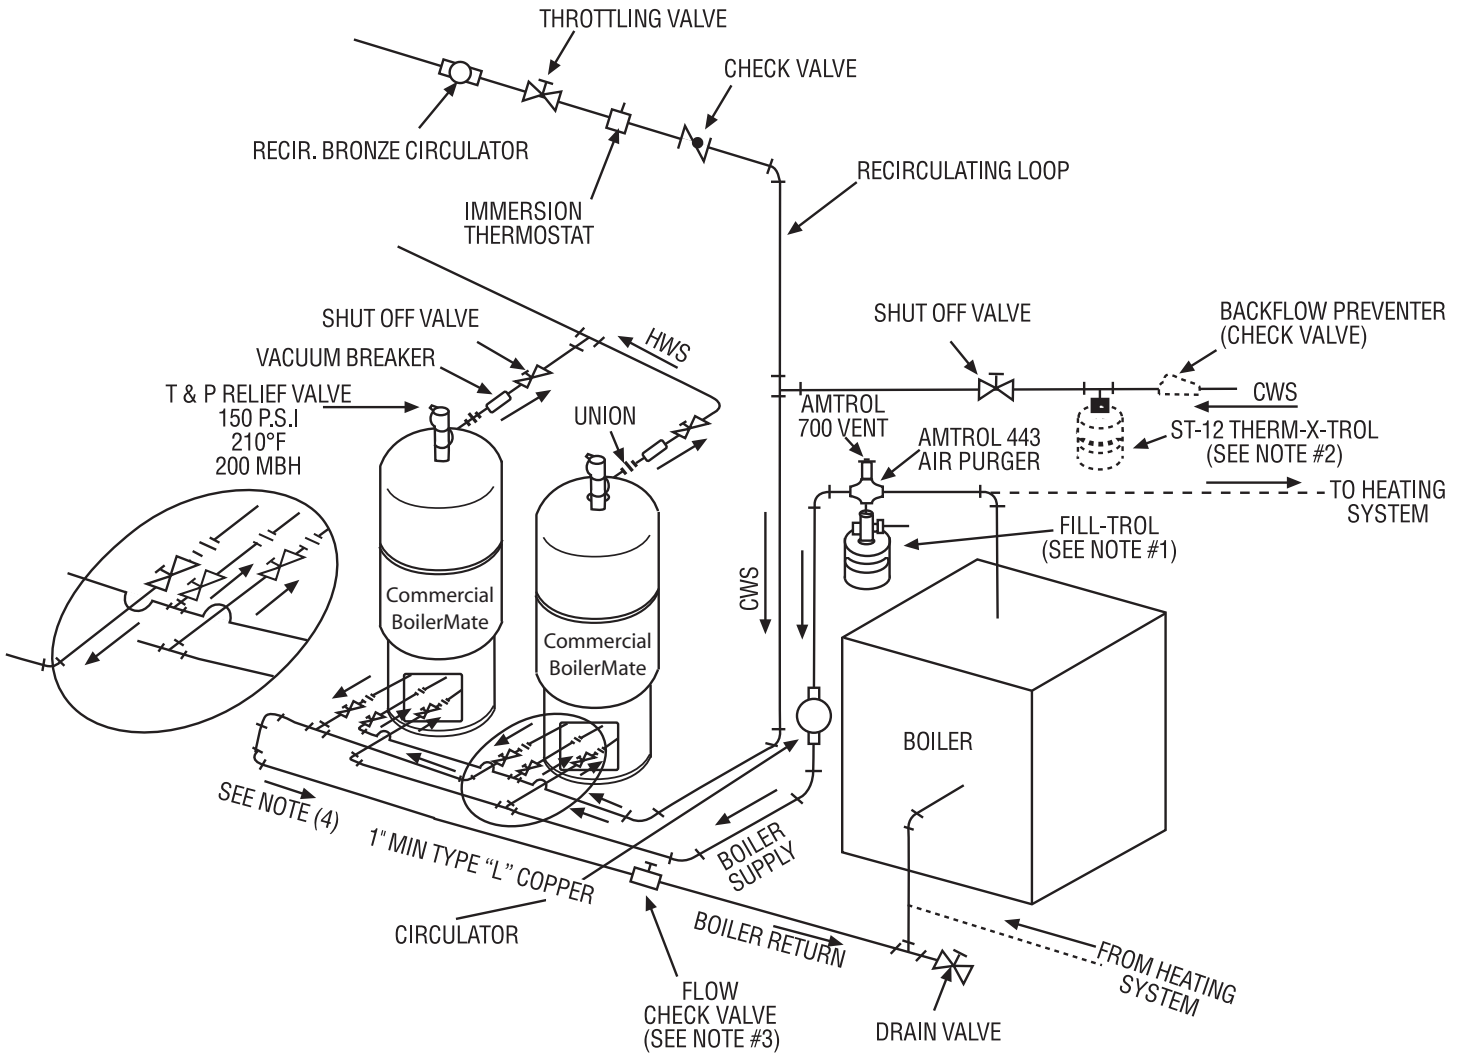

NOTES:

1. FILL-TROL MUST BE SIZED TO ACCOMMODATE THE THERMAL EXPANSION, WITHIN THE BOILER OPERATING RANGE.
2. THERM-X-TROL IS REQUIRED WHEN THE DOMESTIC WATER SYSTEM HAS A BACKFLOW PREVENTION DEVICE OR CHECK VALVE ON THE INCOMING WATERLINE.
3. REQUIRED WHEN BOILER IS USED FOR BOTH SPACE HEATING AND DOMESTIC HOT WATER, (OR WHEN A FLOW CONTROL IS REQUIRED).