



THERMAL EXPANSION TANKS

TYPICAL SPECIFICATIONS

THERM-X-TROL® ST Series Thermal Expansion Tank

For use with Deep Drawn models ST-5C, ST-12C and ST-20VC

The Domestic Hot Water System shall include an AMTROL THERM-X-TROL pre-charged diaphragm expansion tank to accommodate thermally expanded water generated during normal system operation; limiting the pressure increase to the maximum allowed for the system components.

Furnish and install as shown on plans a THERM-X-TROL Model ST-____-C or equal with a Total Tank Volume of ____ gal., a Diameter of ____ (in./mm), a Height of ____ (in./mm) and a Maximum Working Pressure of ____ (psig/BAR). Tank shall have a Deep-Drawn steel shell with no longitudinal welds or “T” joints. A Butyl rubber diaphragm shall be affixed to the pressure shell via a circumferentially grooved seal.


The internal water chamber shall include a molded Polypropylene liner with a silver-ion based Antimicrobial compound; tested to Standard JIS Z 2801 for efficacy in the reduction of Legionella (*L. pneumophila*), Staphylococcus (*S. aureus*) and Coliform (*E. coli*) bacteria on its surface.

The water connection shall be 304L Stainless Steel with a Turbulator™ circulation device inserted to encourage reduction of stagnant water within the tank water chamber.

The tank shall be constructed, tested and stamped in accordance with Section VIII, Division 1 of the ASME Code. All welds to conform to ASME Section IX. Tanks shall carry NSF Standard 61 and IAPMO Lead-Free listings. The manufacturer shall have at least five years experience in the fabrication of diaphragm-type, ASME expansion tanks and employ ASME-certified inspectors within the facility.

Model Number	Tank Volume		A Tank Diameter		B Tank Height	
	Gal	Lit	In	mm	In	mm
ST-5C	2.0	8	8	203	14	356
ST-12C	6.4	24	12	305	18	457
ST-20VC	8.6	33	12	305	22	559

Maximum Working Pressure: 150 PSIG (10.3 bar) or 175 PSIG (12.1 bar)

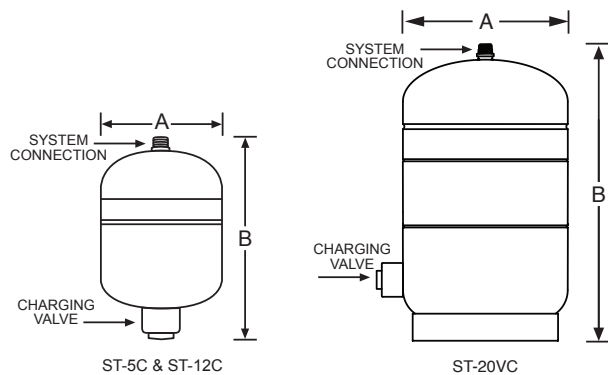

1400 Division Road, West Warwick, RI 02893 USA
 T: 800.426.8765 F: 800.293.1519

www.amtrol.com

